

ICPI TECH SPEC NUMBER • 2

Construction of Interlocking Concrete Pavements

© 1995 ICPI Tech Spec No. 2 Interlocking Concrete Pavement Institute · Revised May 2007 · All rights reserved.

Adequate compaction of the soil subgrade and aggregate base materials are essential to the long-term performance of interlocking concrete pavements.

Purpose

This technical bulletin gives construction guidelines to design professionals and contractors of interlocking concrete pavements. The bulletin reviews the steps in constructing an aggregate base, bedding sand and concrete pavers. This pavement structure is commonly used for pedestrian and vehicular applications. Pedestrian areas, driveways, and areas subject to limited vehicular use are paved with units 2 3 / 8 in. (60 mm) thick. Streets and industrial pavements should be paved with units at least 3 1 / 8 in. (80 mm) thick. Aggregate bases stabilized with asphalt or cement are recommended under very heavy loads, and over weak or saturated soil subgrades. These are sometimes used when adequate aggregates are not available or when a stabilized base is more economical than unstabilized aggregate. Concrete pavers made in the U.S. should meet or exceed the requirements established in the American Society for Testing and Materials (ASTM) C 936, Standard Specification for Solid Interlocking Concrete Paving Units. Requirements of this standard include a minimum average compressive strength of 8,000 psi (55 MPa), average absorption no greater than 5%, resistance to at least 50 freeze-thaw cycles with average material loss not exceeding 1%, and conformance to abrasion resistance tests. Concrete pavers made in Canada are required to meet or exceed requirements set forth by the Canadian Standards Association CSA-A231.2 Precast Concrete Pavers. This standard requires a minimum average cube compressive strength of 7,250 psi (50 MPa) or 5,800 psi (40 MPa) at delivery. There should be no greater than 500 g/m² of material lost after 50 freeze thaw test cycles while immersed in water with a 3% saline solution. Installation steps include job planning, layout, excavating and compacting the soil subgrade, applying geotextiles (optional), spreading and compacting the sub-base and/or base aggregates, constructing edge restraints, placing and screeding the bedding sand, and placing concrete pavers.

Job Planning

Prior to excavating, check with the local utility companies to ensure that digging does not damage underground pipes or wires. Many localities have one telephone number to call at least two days before excavation for marking utility line locations. Overhead clearances should be checked so that equipment does not interfere with wires. Site access by vehicles and equipment should be established so that the job can be built without delays.



Figure 1. Excavation of the soil subgrade.



Figure 2. Compacting the soil subgrade.

Layout

In preparing for excavation, the area to be removed should be marked with stakes. The stakes should be a slight distance away from the area to be removed so that they are not removed during excavation. The stakes should be marked to establish grades, or

have string lines pulled and tied to them. Slopes should be a minimum of 1.5%. In the case of roads, the minimum longitudinal slope should be 1% with a minimum cross slope of 2%. Grade stakes should be checked periodically during the job to be sure that they have not been disturbed.

Excavating, Drainage and Compacting the Soil Subgrade

During and after excavation, the soil should be inspected for organic materials or large rocks. If organic materials, roots, debris, or rocks remain, they should be removed and replaced with clean, compacted backfill material. Free-standing water saturating the soil should be removed. After it is removed, low, wet areas can be stabilized with a layer of crushed stone and/or cement. Typical 4 in. (100 mm) diameter perforated drainage pipes surrounded with minimum 3 in. (75 mm) of No. 57 or similar open-graded stone is wrapped in geotextile. The surface of the stone is even with the top of the compacted soil subgrade. The stone and geotextile pipe assembly is placed along the pavement perimeter to remove excess water in the subgrade soil and base. The perforated pipe should be sloped and directed to outlets at the sides or ends of the pavement. The pipe outlets should be covered with screens to prevent animal ingress. Drainage is recommended in clay soils or other slow draining soils subject to vehicular traffic. Soil subgrade drainage extends pavement performance to the extent that the small additional investment is returned many times in additional pavement service years. Compaction of the soil subgrade is critical to the performance of interlocking concrete pavements. Adequate compaction will minimize settlement. Compaction should be at least 98% of standard Proctor density as specified in ASTM D 698. However, modified Proctor density (ASTM D 1557) is preferred, especially for areas under constant vehicular traffic. This compaction standard may not be achievable in extremely saturated or very fine soils. Stabilization of the soil subgrade may be necessary in these situations. Compaction equipment varies with the type of subgrade soil. Manufacturers of compaction equipment can provide guidance on which machines should be applied to various types of soil. Table 1 gives general guidance on applying the right machines to various soil types. Monitoring soil moisture content is important to reaching the compaction levels described above. Soil moisture and density measurements should be taken to control and verify the degree of compaction. The moisture content and compacted density of the subgrade soil should be checked for compliance to specifications before installing geotextiles.

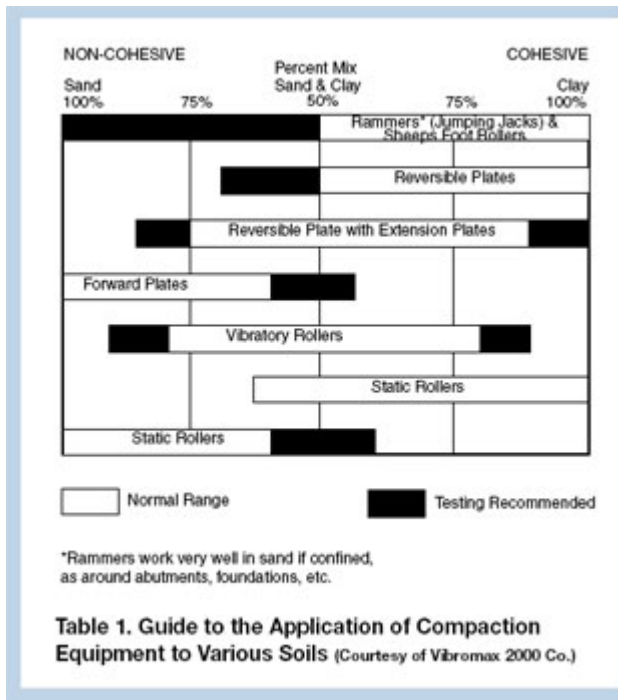


Table 2. Geotextile Physical Property Requirements¹
 < 50% geotextile elongation / > 50% geotextile elongation^{2,3}

Survivability Level	Grab Strength ASTM D 4632 (lbs)	Puncture Resistance ASTM D 4833 (lbs)	Trapezoid Tear Strength ASTM D 4533 (lbs)
High	270/180	100/75	100/75
Medium	180/115	70/40	70/40

- Additional Requirements** **Test Methods**
- Apparent Opening Size (AOS)** **ASTM D 4751**
- <50% soil passing a No. 200 (75 µm) sieve, AOS <0.6 mm.
 - >50% soil passing a No. 200 (75 µm) sieve, AOS < 0.3 mm.
- Permeability** **ASTM D 4491**
- k of the fabric >k of the soil (permeability times the nominal geotextile thickness).
- Ultraviolet Degradation** **ASTM D 4355**
- At 150 hours exposure, 70% strength retained for all cases.
- Geotextile Acceptance** **ASTM D 4759**

¹ Values shown are minimum roll average values. Strength values are in the weaker principle direction.

² Elongation as determined by ASTM D 4632.

³ The values of geotextile elongation do not imply the allowable consolidation properties of the subgrade soil. These must be determined by separate investigation.

Recommended Overlaps	
Soil Strength (CBR)	Overlap Unsewn (in.)
Less than 1	----
1-2	38
2-3	30
3 & above	24

Applying Geotextiles (Optional)

Geotextile fabric may be used in areas where soil remains saturated part of the year, where there is freeze and thaw, or over clay

and moist silty subgrade soils. As a separation layer, they prevent soil from being pressed into the aggregate base under loads, especially when saturated, thereby reducing the likelihood of rutting. When geotextiles are used they preserve the load bearing capacity of the base over a greater length of time than placement without them. Woven or non-woven fabric may be used under the base with a minimum equivalent opening size of No. 3050 sieve. Table 2 lists minimum requirements of geotextiles for base consolidation and soil separation. These are from Task Force 25 AASHTO Guide Specification and Test Procedures for Geotextiles (1990). The minimum down slope overlap should be at least 12 in. (300 mm). When the fabric is placed in the excavated area, it should be turned up along the sides of the opening, covering the sides of the base layer. There should be no wrinkles on the bottom. When the aggregate is dumped on the fabric, the tires from trucks should be kept off the fabric to prevent wrinkling.

Spreading and Compacting the Sub-base and/or Base Aggregates

Specifications typically used by cities, states, or provinces for aggregate base materials under flexible asphalt pavements are adequate for interlocking concrete pavements. If no specifications are available use the recommended grading for the aggregate base shown in Table 3. Spread and compact the base in 4 to 6 in. (100 to 150 mm) lifts. High force compaction equipment can compact thicker lifts. Consult with compaction equipment manufacturer for guidance. Frozen base material should not be installed, nor should material be placed over a frozen soil subgrade. The thickness of the base is determined by traffic, soil type, subgrade soil drainage and moisture, and climate. Sidewalks, patios and pedestrian areas should have a minimum base thickness (after compaction) of 4 in. (100 mm) over well-drained soils. Residential driveways on well-drained soils should be at least 6 in. (150 mm) thick. In colder climates, continually wet or weak soils will require that bases be at least 2 to 4 in. (50 to 100 mm) thicker.



Figure 3. Application of the geotextile under aggregate base.

Table 3. Grading Requirements for Dense Graded Material

Sieve Size (Square Openings)	Design Range ^(a) %Passing		Job Mix Tolerance %Passing	
	Bases	Subbases	Bases	Subbases
2" (50 mm)	100	100	-2	-3
1 1/2" (37.5 mm)	95-100	90-100	±5	±5
3/4" (19 mm)	70-89	—	±8	—
3/8" (9.5 mm)	50-70	—	±8	—
No. 4 (4.75 mm)	35-55	30-60	±8	±10
No. 30 (600 µm)	12-55	—	±5	—
No. 200 (75 µm)	0-8 ^(b)	1-12 ^(b)	±3	±5

^(a) Job mix formula should be selected with due regard to availability of materials in the area of the project. Job mix tolerances may permit acceptance of test results outside the design range.

^(b) Determined by wet sieving. Where frost and free moisture are indicative of site conditions, a lower percentage passing the No. 200 (75 µm) sieve shall be specified.

Note: ASTM D 2940 corresponds closely to this National Stone Association developed specification. While local or state highway specifications may be substituted for the design ranges above, the fraction finer than the No. 200 (75 µm) sieve should be maintained.

Local, state or provincial engineering standards for base thickness can be applied to streets constructed with interlocking concrete pavers. Non freeze-thaw areas with well-drained soils should have at least a 6 in. (150 mm) thick base. Minimum base thicknesses for residential streets are 8 to 10 in. (200 to 250 mm). Greater thicknesses are often used in regions with numerous freeze-thaw cycles, expansive soils, or very cold climates. A qualified civil engineer familiar with local soils and traffic conditions should be consulted to determine the appropriate base thickness for streets and heavy-duty, industrial pavements. Many localities determine base thickness with the 1993 Guide for the Design of Pavement Structures published by the American Association of State Highway and Transportation Officials (AASHTO). The AASHTO procedure calculates the structural number (SN) of the strength coefficients of each base and pavement layer. The SN is determined by assessing the traffic loads, soils, and environmental factors (e.g., drainage, freeze-thaw). The layer coefficient recommended for 3 1 / 8 in. (80 mm) thick pavers on 1 in. (25 mm) bedding sand is 0.44 per inch (25 mm), i.e., the SN = 4 1 / 8 x 0.44 = 1.82. Base thicknesses can be readily determined by using the charts in ICPI Tech Spec 4, Structural Design of Interlocking Concrete Pavement for Roads and Parking Lots or ICPI Lockpave Software. Like compaction of the soil subgrade, adequate compaction of the base is critical to minimizing settlement of interlocking concrete pavements. Special attention should be given to achieving compaction standards

adjacent to edge restraints, catch basins and utility structures. When spread and compacted, the aggregate base should be at its optimum moisture. Bases for pedestrian areas and residential driveways should be compacted a minimum 98% of standard Proctor density. For vehicular areas, compaction should be at least 98% of modified Proctor density as determined by ASTM D 1557, or AASHTO T180. While the highest percentage compaction (100%) is preferred, it may not be achievable on weak or saturated soils. Density measurements of the compacted base should be made a nuclear density gauge or other methods approved by the local, state or provincial transportation department. Unless otherwise specified, the compacted thickness of individual lifts and the final base should be $+3/4$ in. to $1/2$ in. (+19 mm to 13 mm). Maintaining consistent lift thickness during compaction will help achieve consistent density. Variation in final base surface elevations should not exceed $+3/8$ in. (+10 mm) when tested with a 10 ft. (3 m) straightedge. The finished surface of a compacted aggregate base should not allow bedding sand to migrate into it. If the surface will allow ingress of bedding sand, a choke course of fine material can be spread and compacted into the surface, or a bitumen tack coat can be applied. The surface of the base course and its perimeter around the edge restraints should be inspected for areas that might allow sand to migrate after installation. Such locations can be joints in curbs, around utility structures or catch basins. These areas should be covered with a geotextile fabric to prevent loss of the bedding sand.

Constructing Edge Restraints

Edge restraints are a key part of interlocking concrete pavements. By providing lateral resistance to loads, they maintain continuity and interlock among the paving units. Aluminum, steel, plastic, or concrete are typical edge restraints. Consult ICPI Tech Spec 3 on edge restraints for recommendations on applications and construction. Edge restraints must be set at the correct level, especially if the tops of the restraints are used for screeding the bedding sand. Their elevations should be checked prior to placing the sand and pavers. Edge restraints are typically installed before the bedding sand and pavers are laid. However, some restraints can be secured into the base as the laying progresses.



Figure 4. Base compaction with a vibratory roller.



Figure 5. Density testing of the aggregate base with a nuclear density gauge.

Placing and Screeding the Bedding Sand

Bedding sand under concrete pavers should conform to ASTM C 33 or CSA A23.1. This material is often called concrete sand. Masonry sand for mortar should never be used for bedding, nor should limestone screenings or stone dust. The bedding sand should have symmetrical particles, generally sharp, washed, with no foreign material. Waste screenings or stone dust should not be used, as they often do not compact uniformly and can inhibit lateral drainage of moisture in the bedding sand. ICPI Tech Spec 17-Bedding Sand Selection for Interlocking Concrete Pavements in Vehicular Applications provides additional guidance on selecting bedding sand. Bedding sand should be spread and screeded to a nominal 1 in. (25 mm) thickness. Frozen or saturated sand should not be installed. If there is an uneven base (due to inconsistent compaction or improper grading), the bedding sand should not be used to compensate for it. Over time, unevenness in the bedding sand will reflect through to the surface. Uneven areas on the base surface must be made level prior to placing the bedding sand. Once the base is complete, screed pipes or rails are placed on it and the bedding sand spread over them. The sand is screeded or smoothed across the pipes with a straight and true strike board. Screed pipes are removed and the resulting void filled with bedding sand. After the sand is screeded it should not be disturbed. Sufficient sand is placed and screeded to stay ahead of the placed pavers. Powered screeding machines that roll on rails and asphalt spreading machines adapted for screeding sand have been successfully used on larger installations to increase productivity.



Figure 6. Screeding the bedding sand.



Figure 7. Placing the concrete pavers.



Figure 8. Saw cutting pavers.

Placing the Concrete Pavers

Concrete pavers can be placed in many patterns depending on the shapes. Herringbone patterns (45 or 90 degree) are recommended in all street applications, as these interlocking patterns provide the maximum load bearing support, and resist creep from starting, braking and turning tires. Chalk lines snapped on the bedding sand or string lines pulled across the surface of the pavers are used as a guide to maintain straight joint lines. Buildings, concrete collars, inlets, etc., are generally not straight and should not be used for establishing straight joint lines. Joint widths between the pavers should be consistent and be between 1 / 16 and 3 / 16 in. (2 and 5 mm). Some pavers are made with spacer bars on their sides. These maintain a minimum joint width, allowing the sand to enter between each unit. Pavers with spacers are generally not placed snug against each other since string lines guide consistent joint spacing. Cut pavers should be used to fill gaps along the edge of the pavement. Pavers are cut with a double bladed splitter or a masonry saw. A saw gives a smooth cut. Gaps less than 3 / 8 in. (10 mm) should be filled with sand or filled by shifting courses of pavers. After an area of pavers is placed, it should be compacted with a vibrating plate compactor, which should be capable of exerting a minimum of 5,000 lbs. (22 kN) of centrifugal compaction force and operate at 75-90 hertz. At least two passes should be made across the pavers to seat the pavers in the bedding sand and force it into the joints at the bottom of the pavers. Dry joint sand is swept into the joints and the pavers compacted again until the joints are full. This may require two or three passes of the plate compactor. If the sand is wet, it should be spread to dry on the pavers before being swept and compacted into the joints. Joint sand may be finer than the bedding sand to facilitate filling of the joints. Bedding sand also can be used to fill the joints, but it may require extra effort in sweeping and compacting. Compaction should be within 6 ft (2 m) of an unrestrained edge or laying face. All pavers within 6 ft (2 m) of the laying face should have the joints filled and be compacted at the end of each day. Excess bedding sand is then removed. The remaining uncompacted edge can be covered with a waterproof covering if there is a threat of rain. This will prevent saturation of the bedding sand, minimizing removal and replacement of the bedding sand and pavers. Final surface elevations should not vary more than + 3 / 8 in. (+10 mm) under a 10 ft (3 m) straightedge, unless otherwise specified. Bond or joint lines should not vary $\pm 1 / 2$ in. (15 mm) over 50 ft (15 m) from taut string lines. The top of the pavers should be 1 / 8 to 3 / 8 in. (3 to 10 mm) above adjacent catch basins, utility covers, or drain channels, with the exception of areas required to meet ADA design guideline tolerances. The top of the installed pavers may be 1

$\frac{1}{8}$ to $\frac{1}{4}$ in. (3 to 6 mm) above the final elevations to compensate for possible minor settling. A small amount of settling is typical of all flexible pavements. Optional sealers or joint sand stabilizers may be applied. See ICPI Tech Spec 5 Cleaning, Sealing and Joint Sand Stabilization of Interlocking Concrete Pavement for further guidance. ICPI Tech Spec 9A Guide Specification for the Construction of Interlocking Concrete Pavement helps translate construction methods and procedures described here into a construction document. Tech Spec 9 provides a template for developing project-specific materials and installation specifications for the bedding and joint sand, plus the concrete pavers. Additional guide specifications and detail drawings for various applications are available at www.icpi.org as well as ICPI Tech Specs. Other ICPI Tech Specs and technical manuals should be referenced for information on design, detailing, construction and maintenance.



Figure 9. Compacting the pavers and bedding sand.



Figure 10. Spreading and sweeping joint sand.



Figure 11. Vibrating sand into the joints.



Figure 12. Excess sand swept from the finished surface will make the pavement ready for traffic.

References

- National Stone Association, Flexible Pavement Design Guide for Roads and Streets. Fourth Edition, Washington, D.C., January 1985.
- National Stone Association, Stone Base Construction Handbook, Second Edition, Washington, D.C., September 1988.

Figures 1-3,6,7,9-10,12 are courtesy of the Waterways Experiment Station, U.S. Army Corp of Engineers. Figure 5 is courtesy of the Portland Cement Association.

Interlocking Concrete Pavement Institute

1444 I St. NW, Suite 700

Washington, D.C. 20005-6542

(202) 712-9036

Fax: (202) 408-0285

In Canada:

P.O. Box 23053

55 Ontario St.

Milton, Ontario L9T 2M0



e-mail: icpi@icpi.org

Web site: www.icpi.org

WARNING: *The content of ICPI Tech Spec Technical Bulletins is intended for use only as a guideline. It is NOT intended for use or reliance upon as an industry standard, certification or as a specification. ICPI makes no promises, representations or warranties of any kind, express or implied, as to the content of the Tech Spec Technical Bulletins and disclaims any liability for damages resulting from the use of Tech Spec Technical Bulletins. Professional assistance should be sought with respect to the design,*

specifications and construction of each project.